



# BACnet CONFORMANCE CERTIFICATE

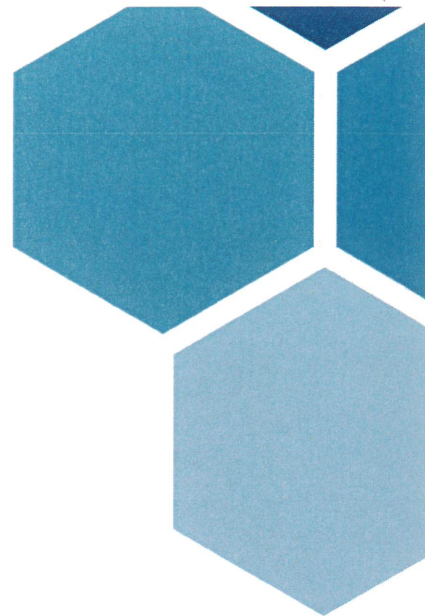

**No. BTL-30765**

WSPCert attests the conformance of the following BACnet implementation to the BACnet standard ISO 16484-5 protocol revision 1.16. The attested conformance refers to the BACnet Interoperability Building Blocks (BIBBs) listed on the BTL Listing bearing the above-mentioned BTL-number.

The BACnet implementation has fulfilled the requirements according to the test standard ISO 16484-6, the BTL Test Plan 18.1 and the BTL Testing Policies, see Test Report number TC51273 of Protocol Test Lab.

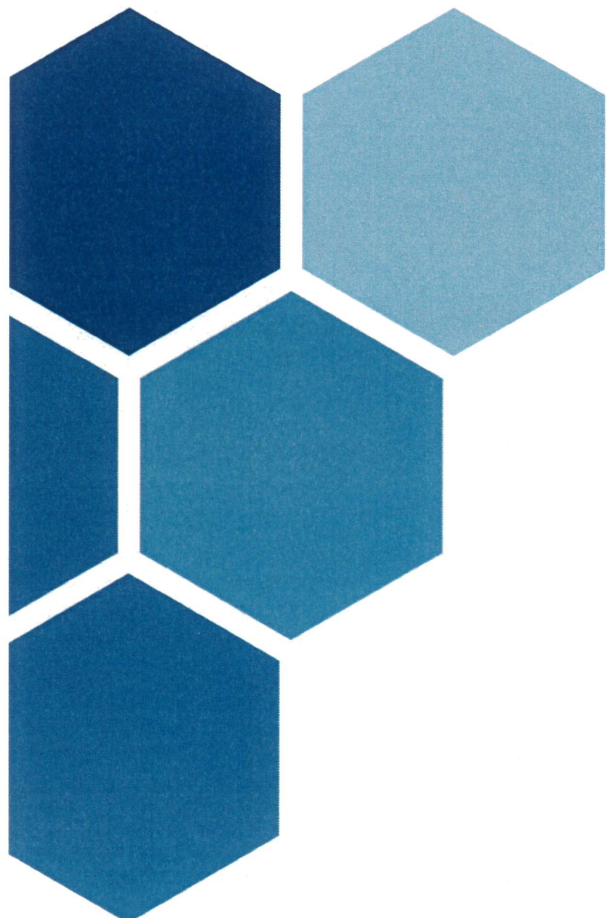

Product name (B-ASC)
<b>Series MSX-Comms Magnesense<sup>®</sup>, Series MSX Pro-Comms Magnesense<sup>®</sup> Model(s)* MSX-xx-x-COM-OPT, MSXP-xx-x-COM-OPT</b>
Firmware version
<b>1.0.0R / BACnet stack 1.1</b>
Vendor
<b>Dwyer Instruments Inc. 102 Indiana Hwy 212 Michigan City, IN 46360, USA</b>

\* where x, OPT is according to listing information

This certificate is valid until **31-Mar-2027**.

**02-Sep-2021**

Date of Initial Certification

Dipl.-Ing. G. Weinmann  
Head of Certification Body